

BELL SYSTEM PRACTICES
Teletypewriter and Manual
Telegraph Station and P.B.X.
Installation and Maintenance

SECTION P30.701
Issue 1, September, 1936
AT&T Co. Standard

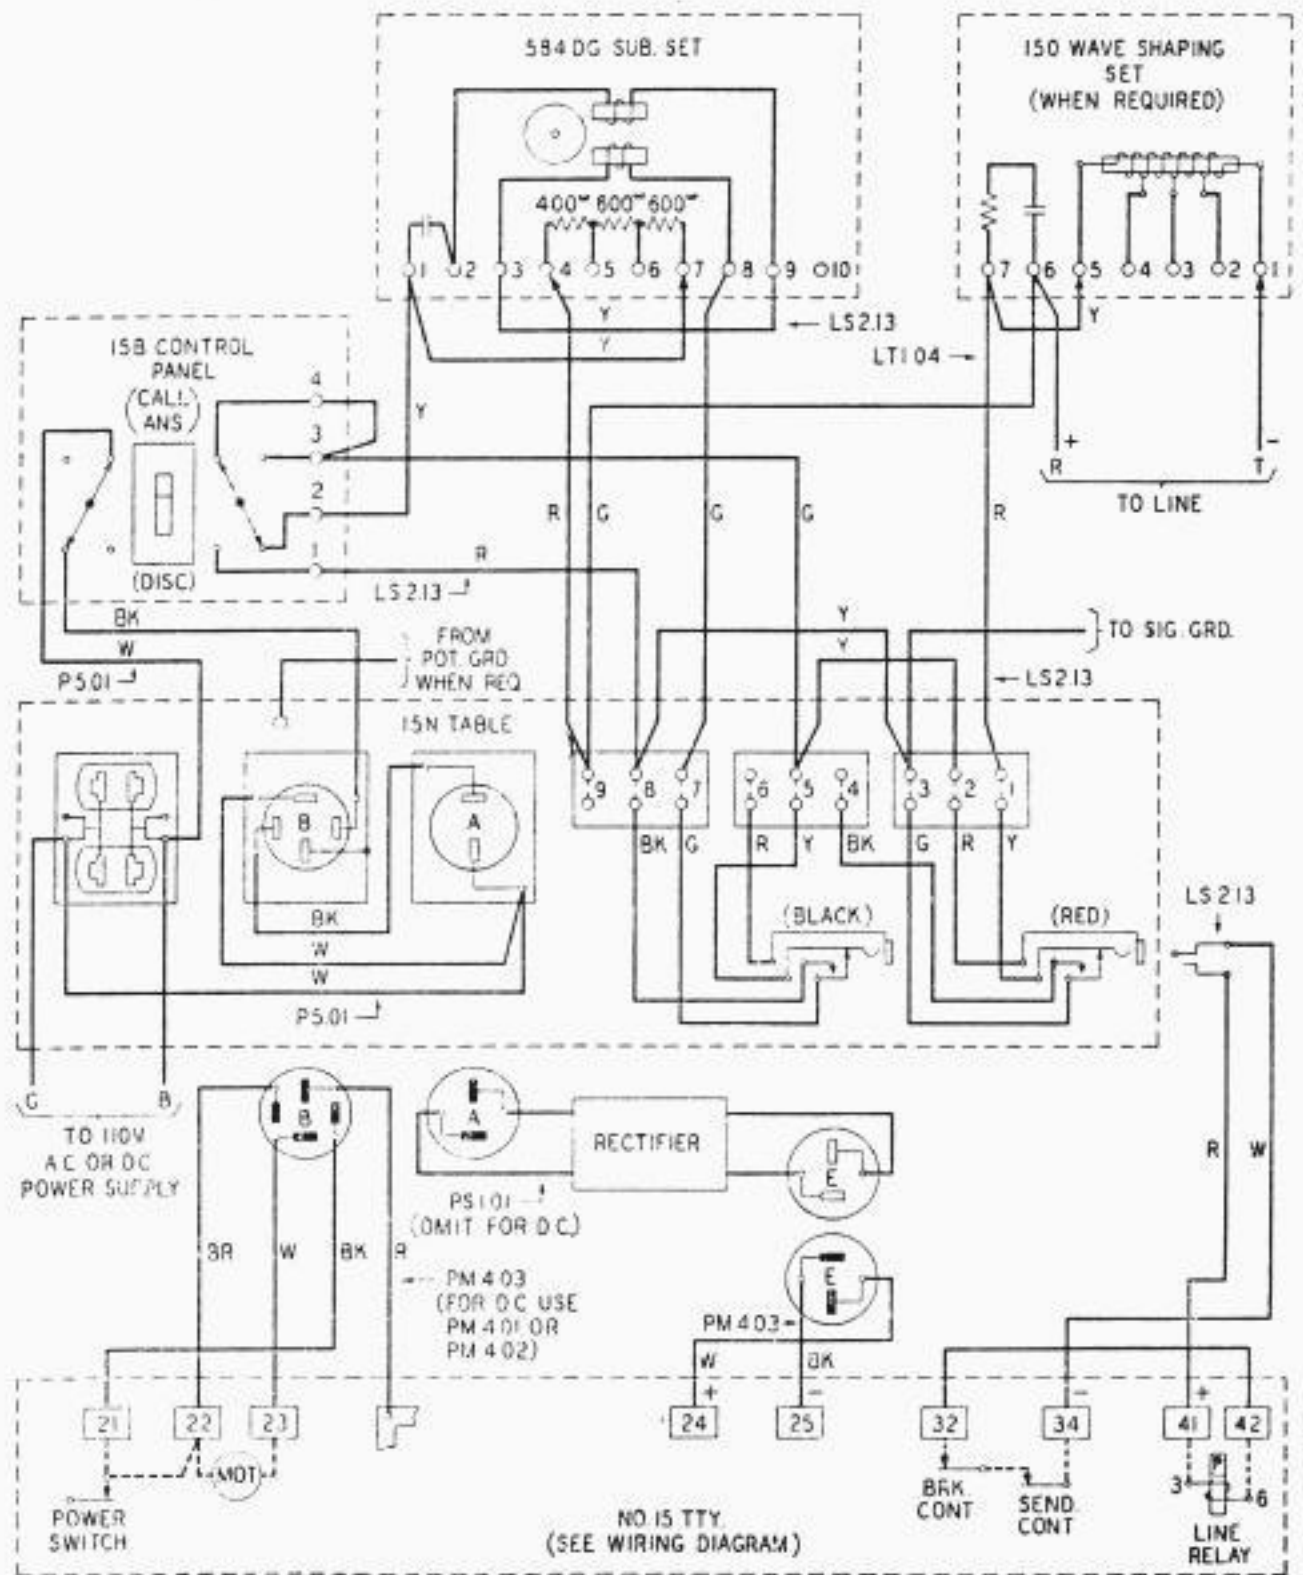


Fig. 1

15-N Table, 15-B Control Panel.
Open Loop, Automatic Flashing Recall.

TWX STATIONS—LOCAL—
OPEN LOOP—AUTOMATIC
FLASHING RECALL—
STATION CONNECTION

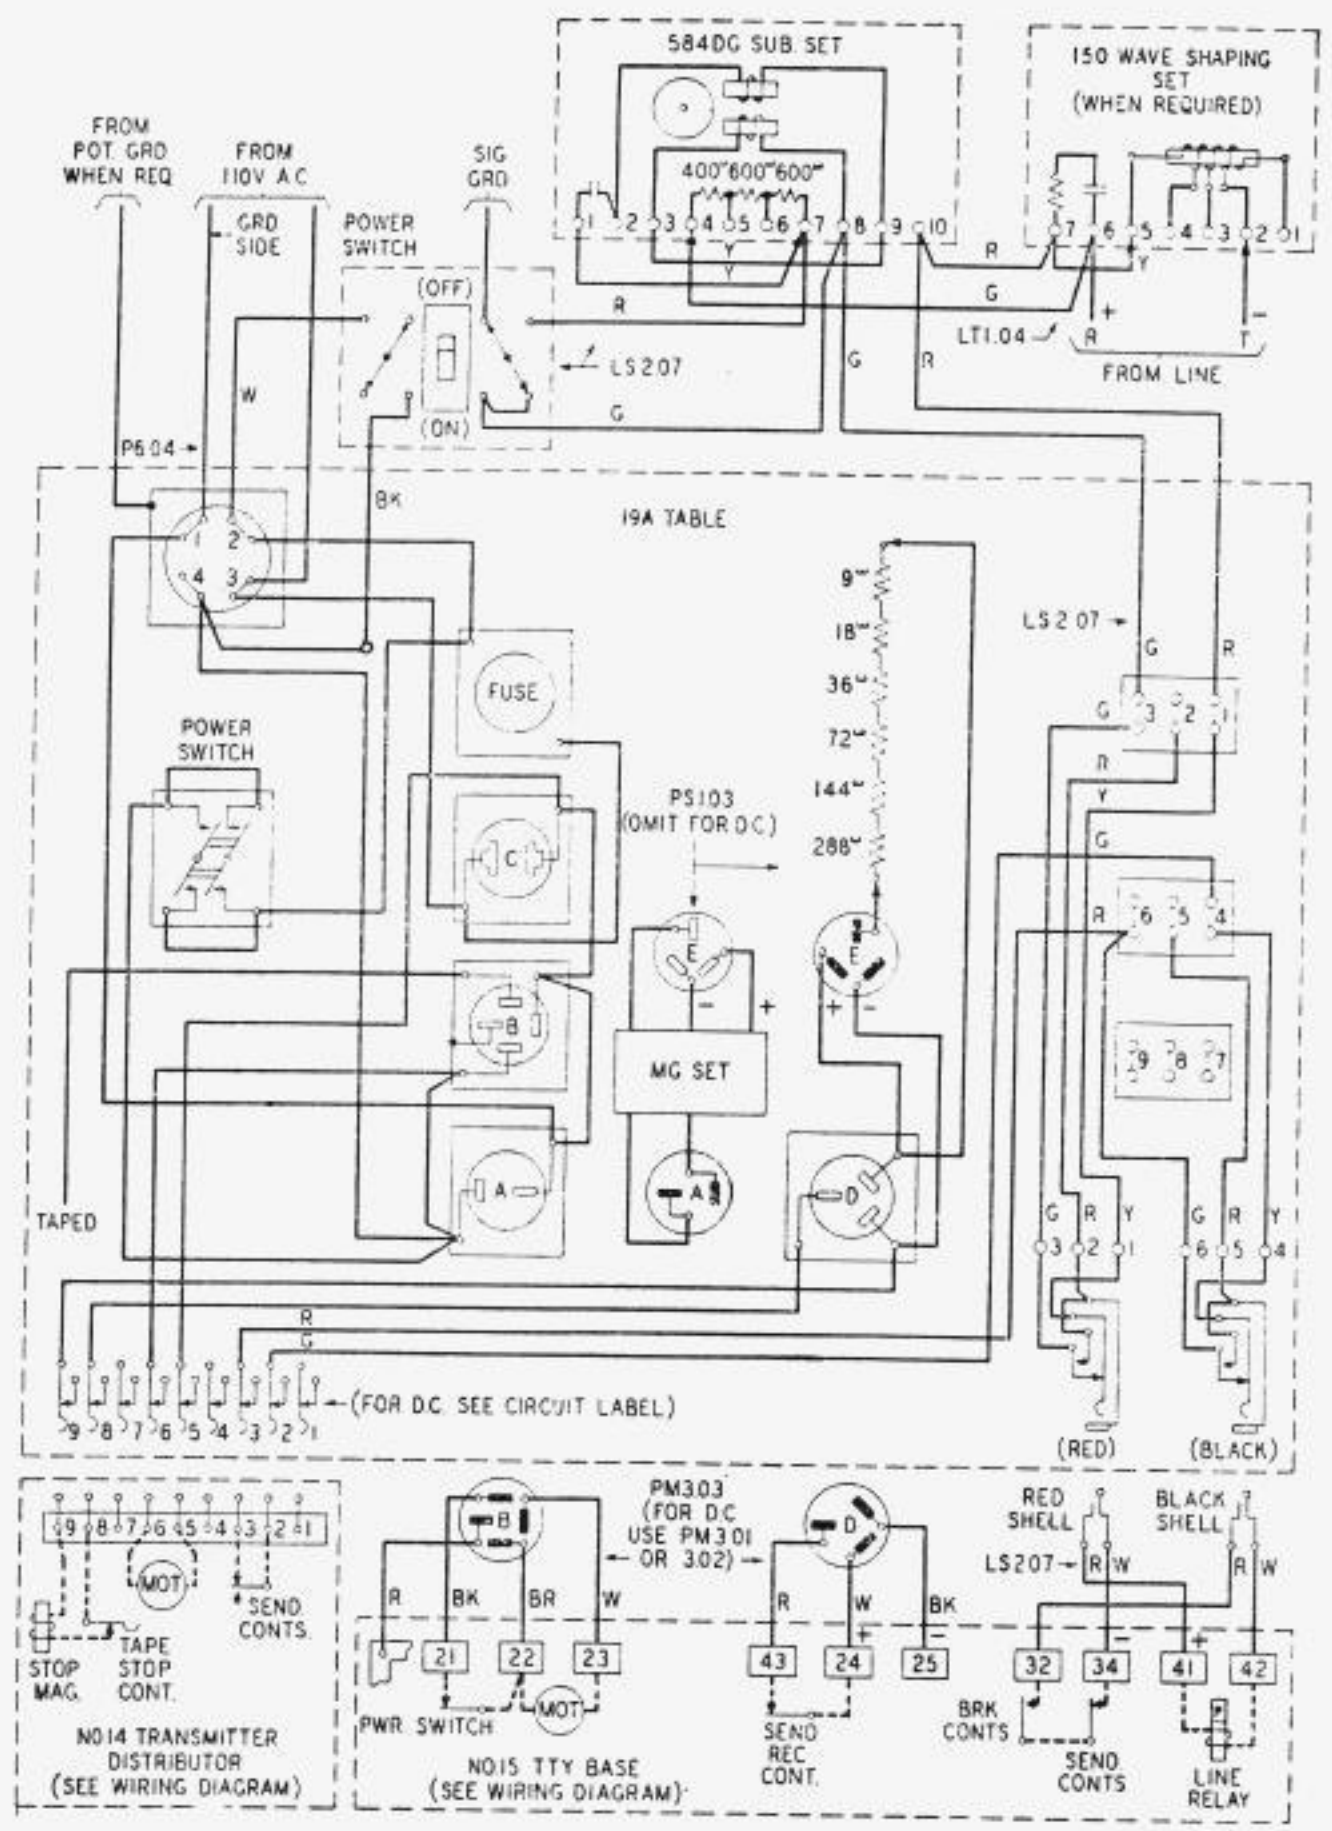


Fig. 2
19-A Table, 126A1 Set.
Open Loop, Automatic Flashing Recall.