

**BELL SYSTEM PRACTICES**  
Teletypewriter Stations


**SECTION P33.010**  
Issue 2, June, 1953  
AT&T Co Standard

## **WIRING DIAGRAM**

### **100-TYPE CABINETS**

#### **1. GENERAL**

- 1.01 This section gives the wiring diagram of the 100-type cabinets.
- 1.02 This section is being reissued to change the main fuse from 30 amp. to 15 amp. and to add power-factor-correction condensers.

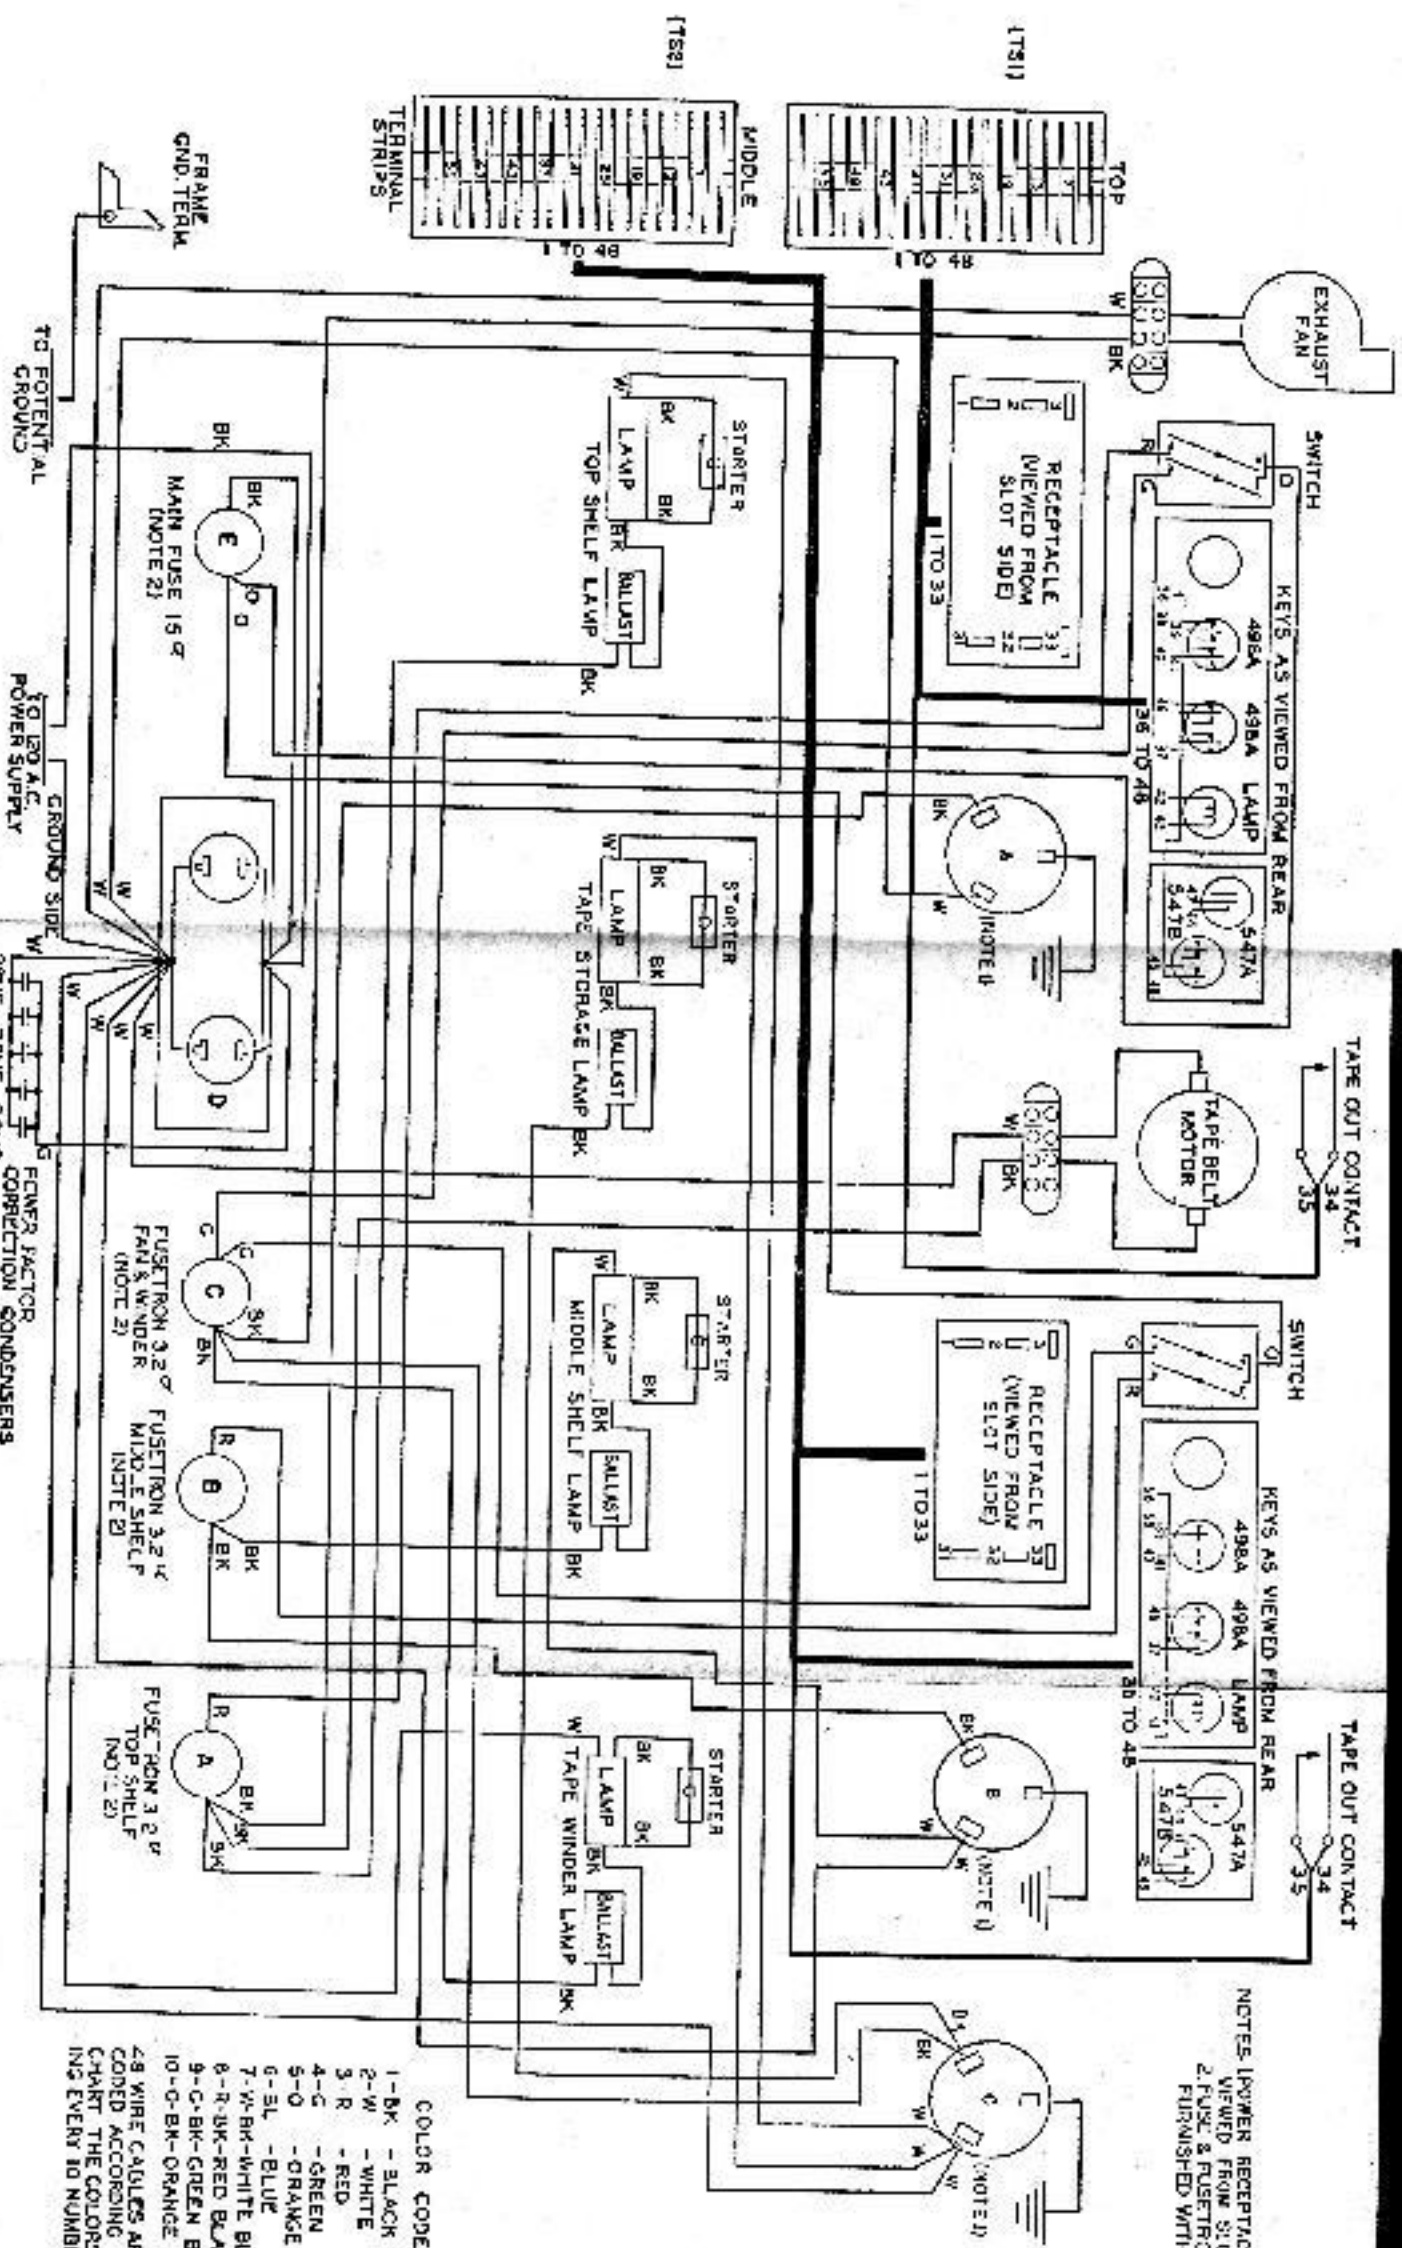


**COLOR CODE**

- 1-BK - BLACK
- 2-W - WHITE
- 3-R - RED
- 4-G - GREEN
- 5-O - ORANGE
- 6-BL - BLUE
- 7-W-BK-WHITE BLACK
- 8-R-BK-RED BLACK
- 9-G-BK-GREEN BLACK
- 10-O-BK-ORANGE BLACK

48 WIRE GAUGES ARE COLOR CODED ACCORDING TO ABOVE CHART THE COLORS REPEAT INS EVERY 10 NUMBERS.


**NOTES:** (LOWER RECEPTACLES VIEWED FROM SLOT SIDE)  
2. FUSE & FUSETRONS NOT FURNISHED WITH CABINET

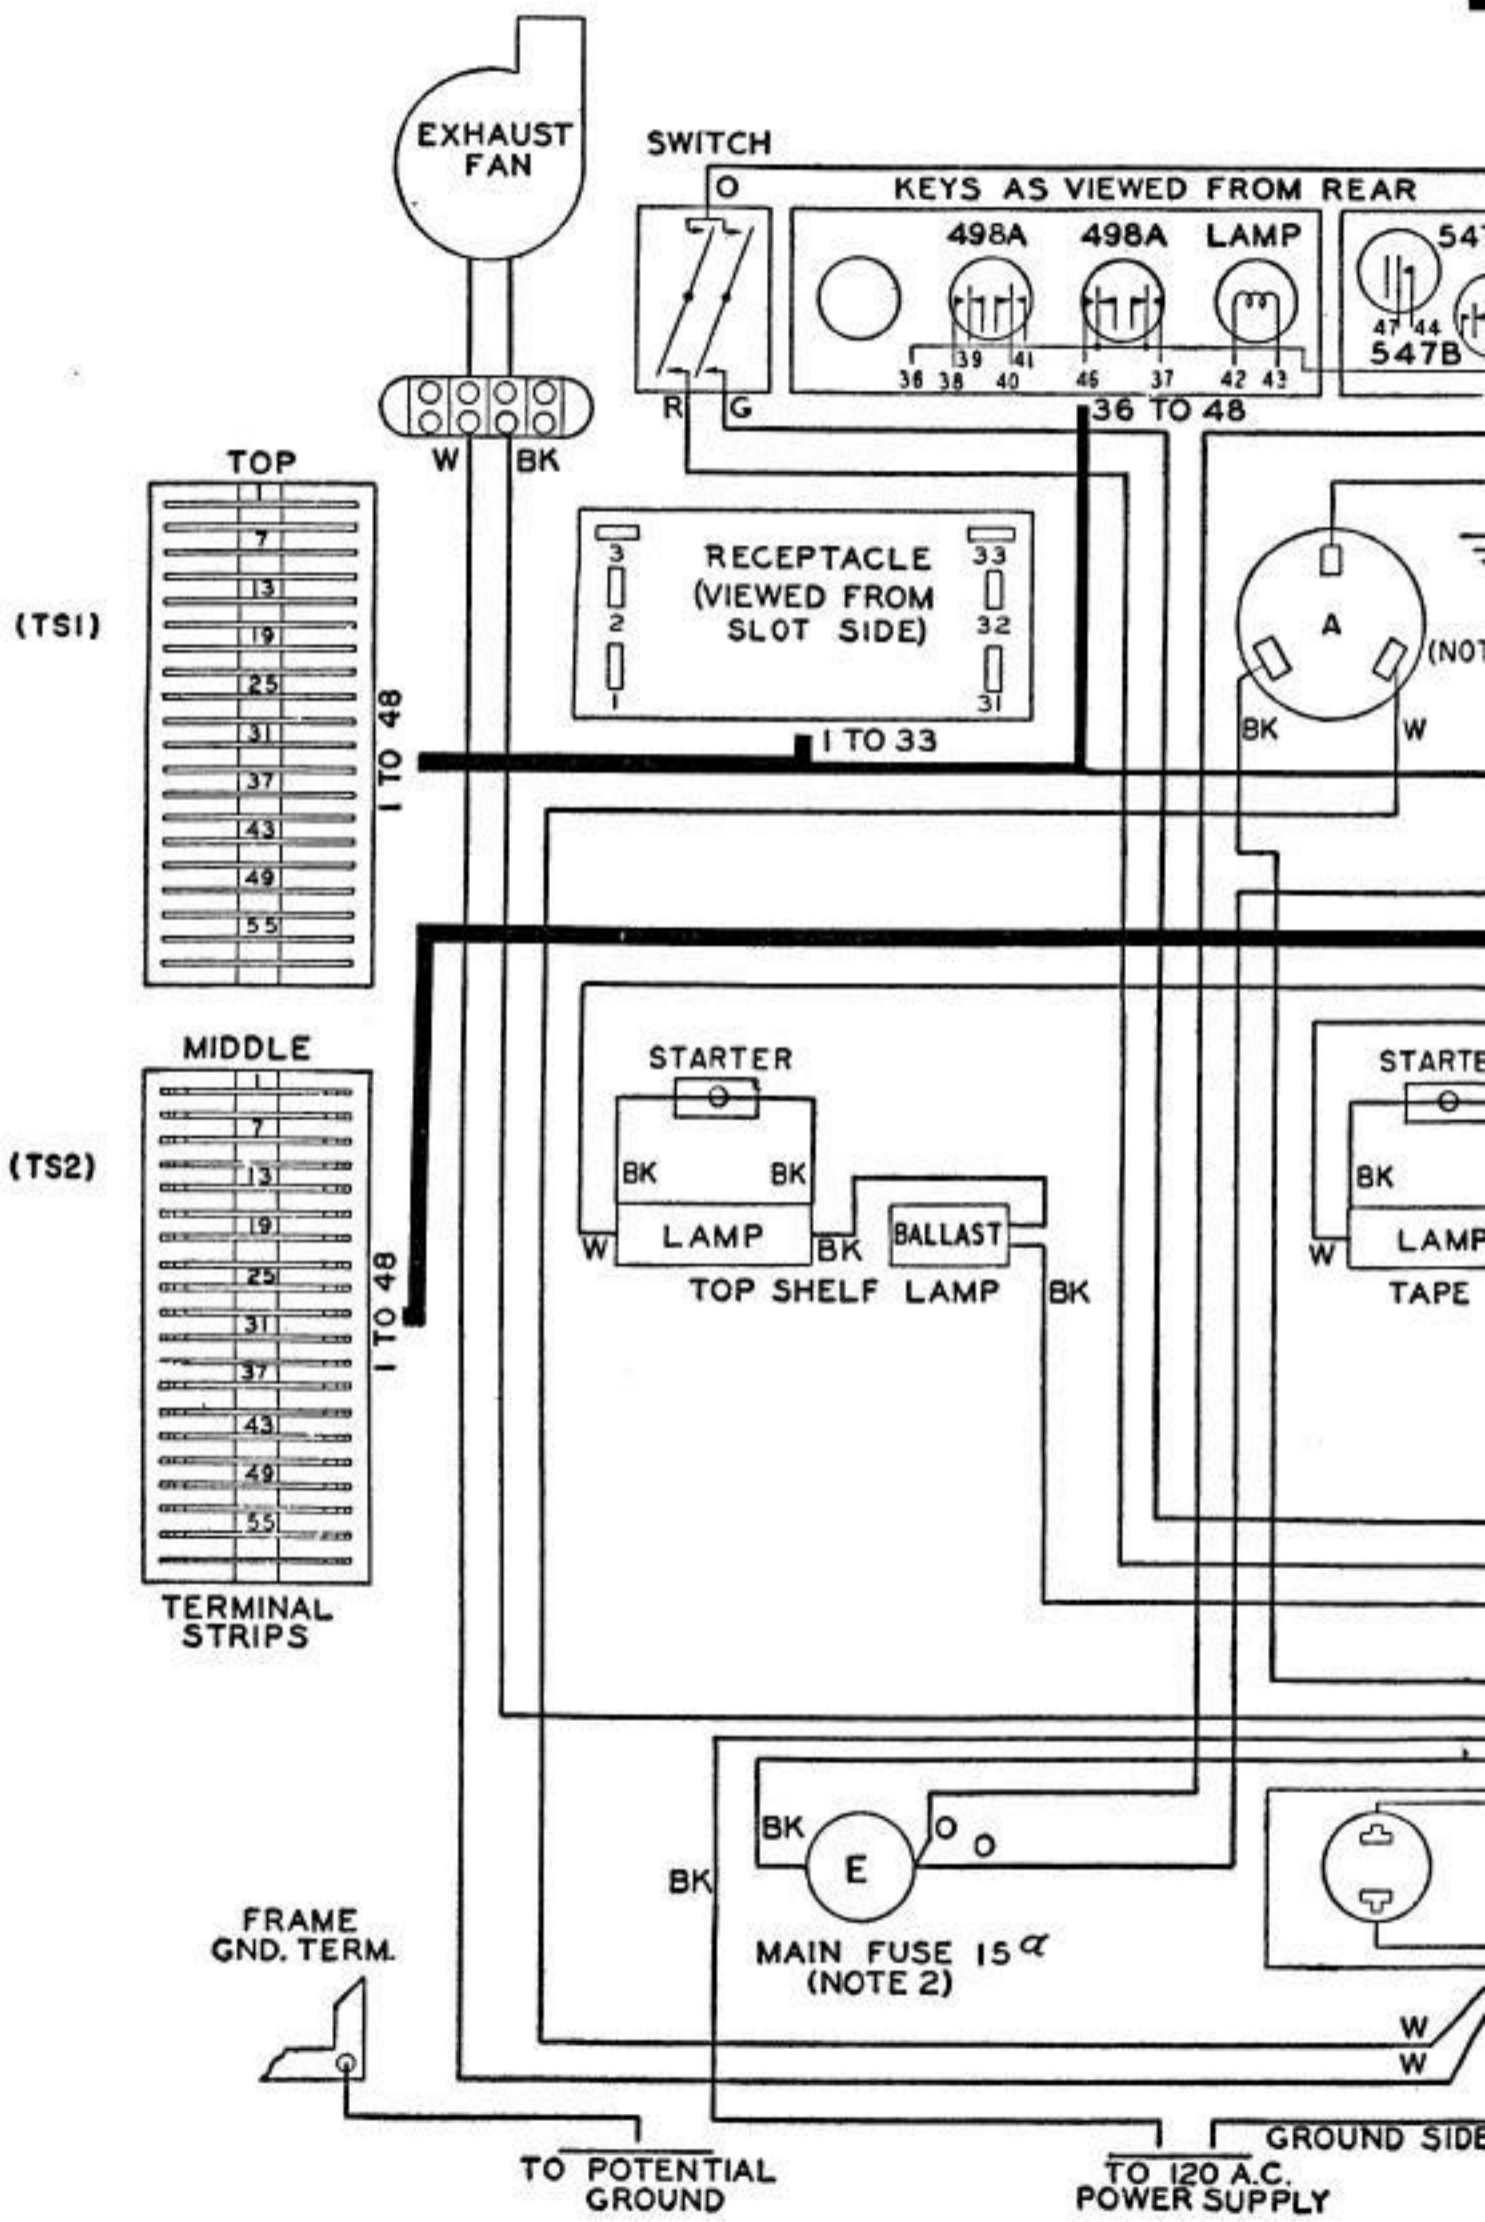

P33.010


Page 2  
2 Pages

WIRING DIAGRAM  
100-TYPE CABINETS

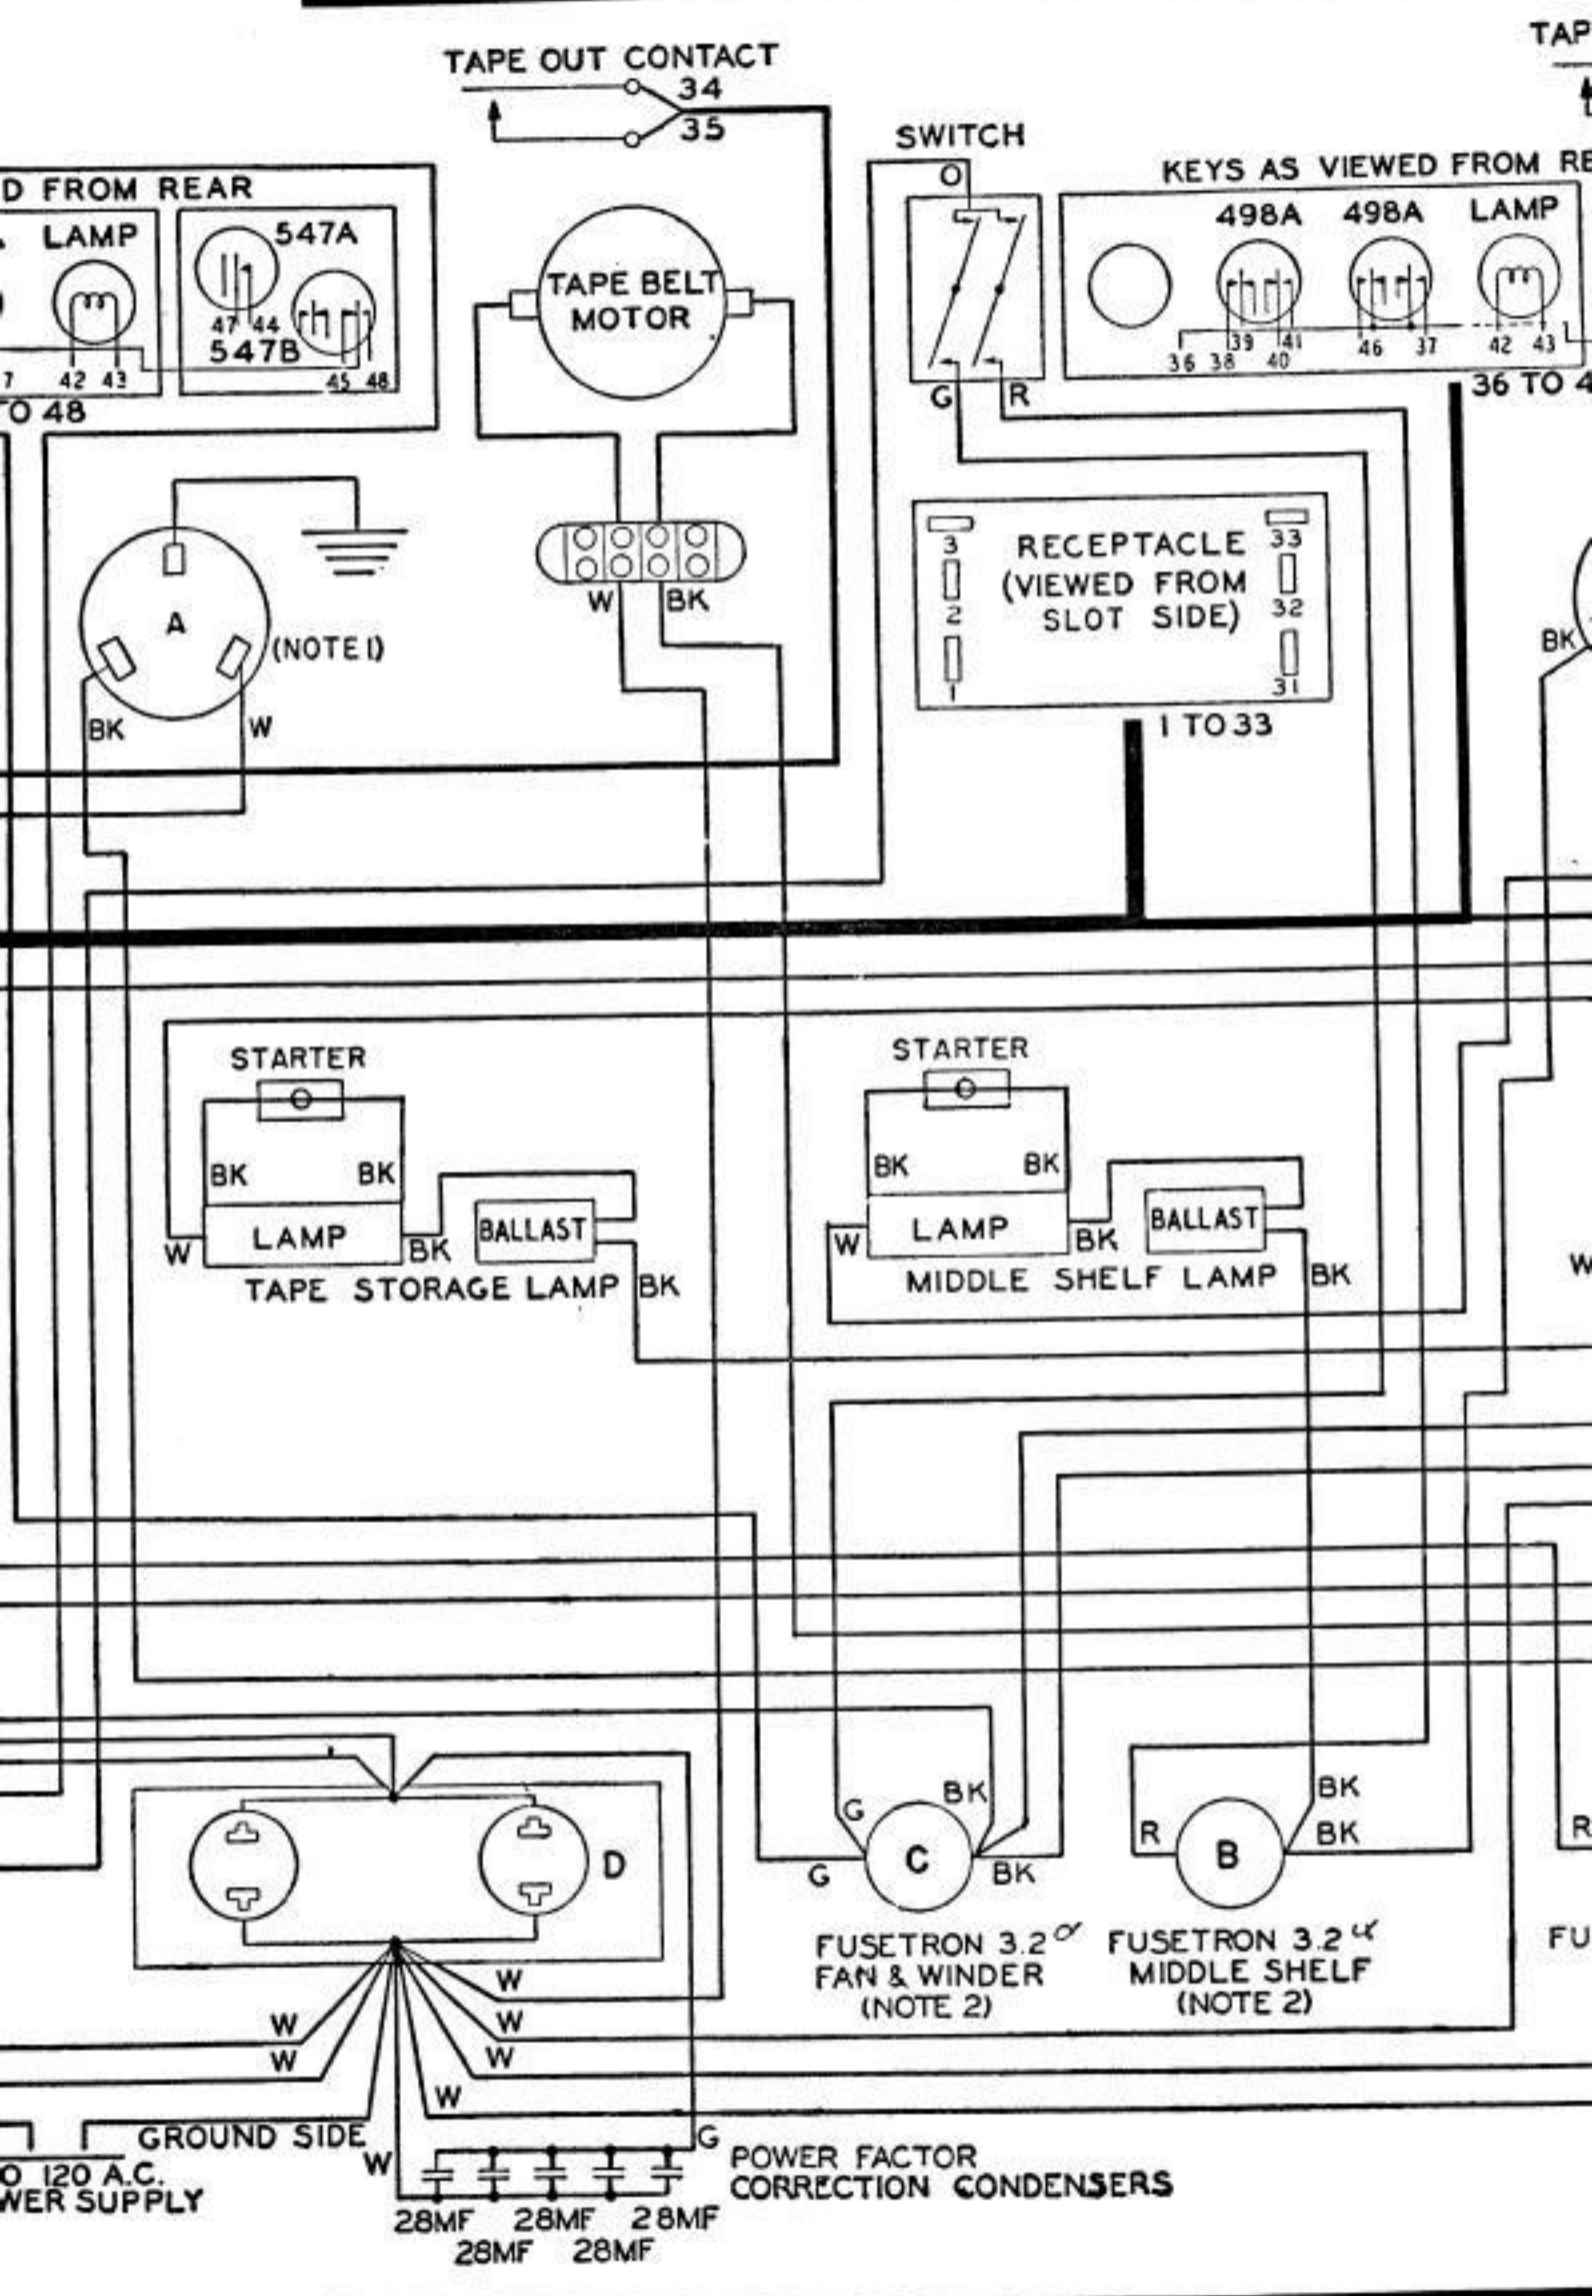


WIRING DIAGRAM  
TAPE CABINETS


TAPE OUT CONTACT



KEYS AS VIEWED FROM REAR

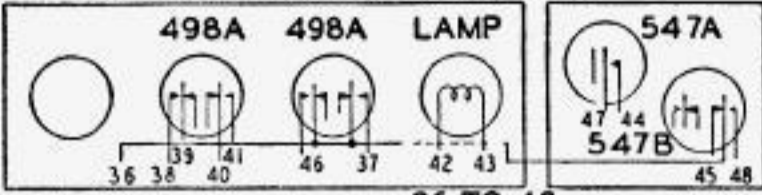

NOTES: 1. POWER RECEPTACLES VIEWED FROM SLOT SIDE  
2. FUSE & FUSETRONS NOT FURNISHED WITH CABINET

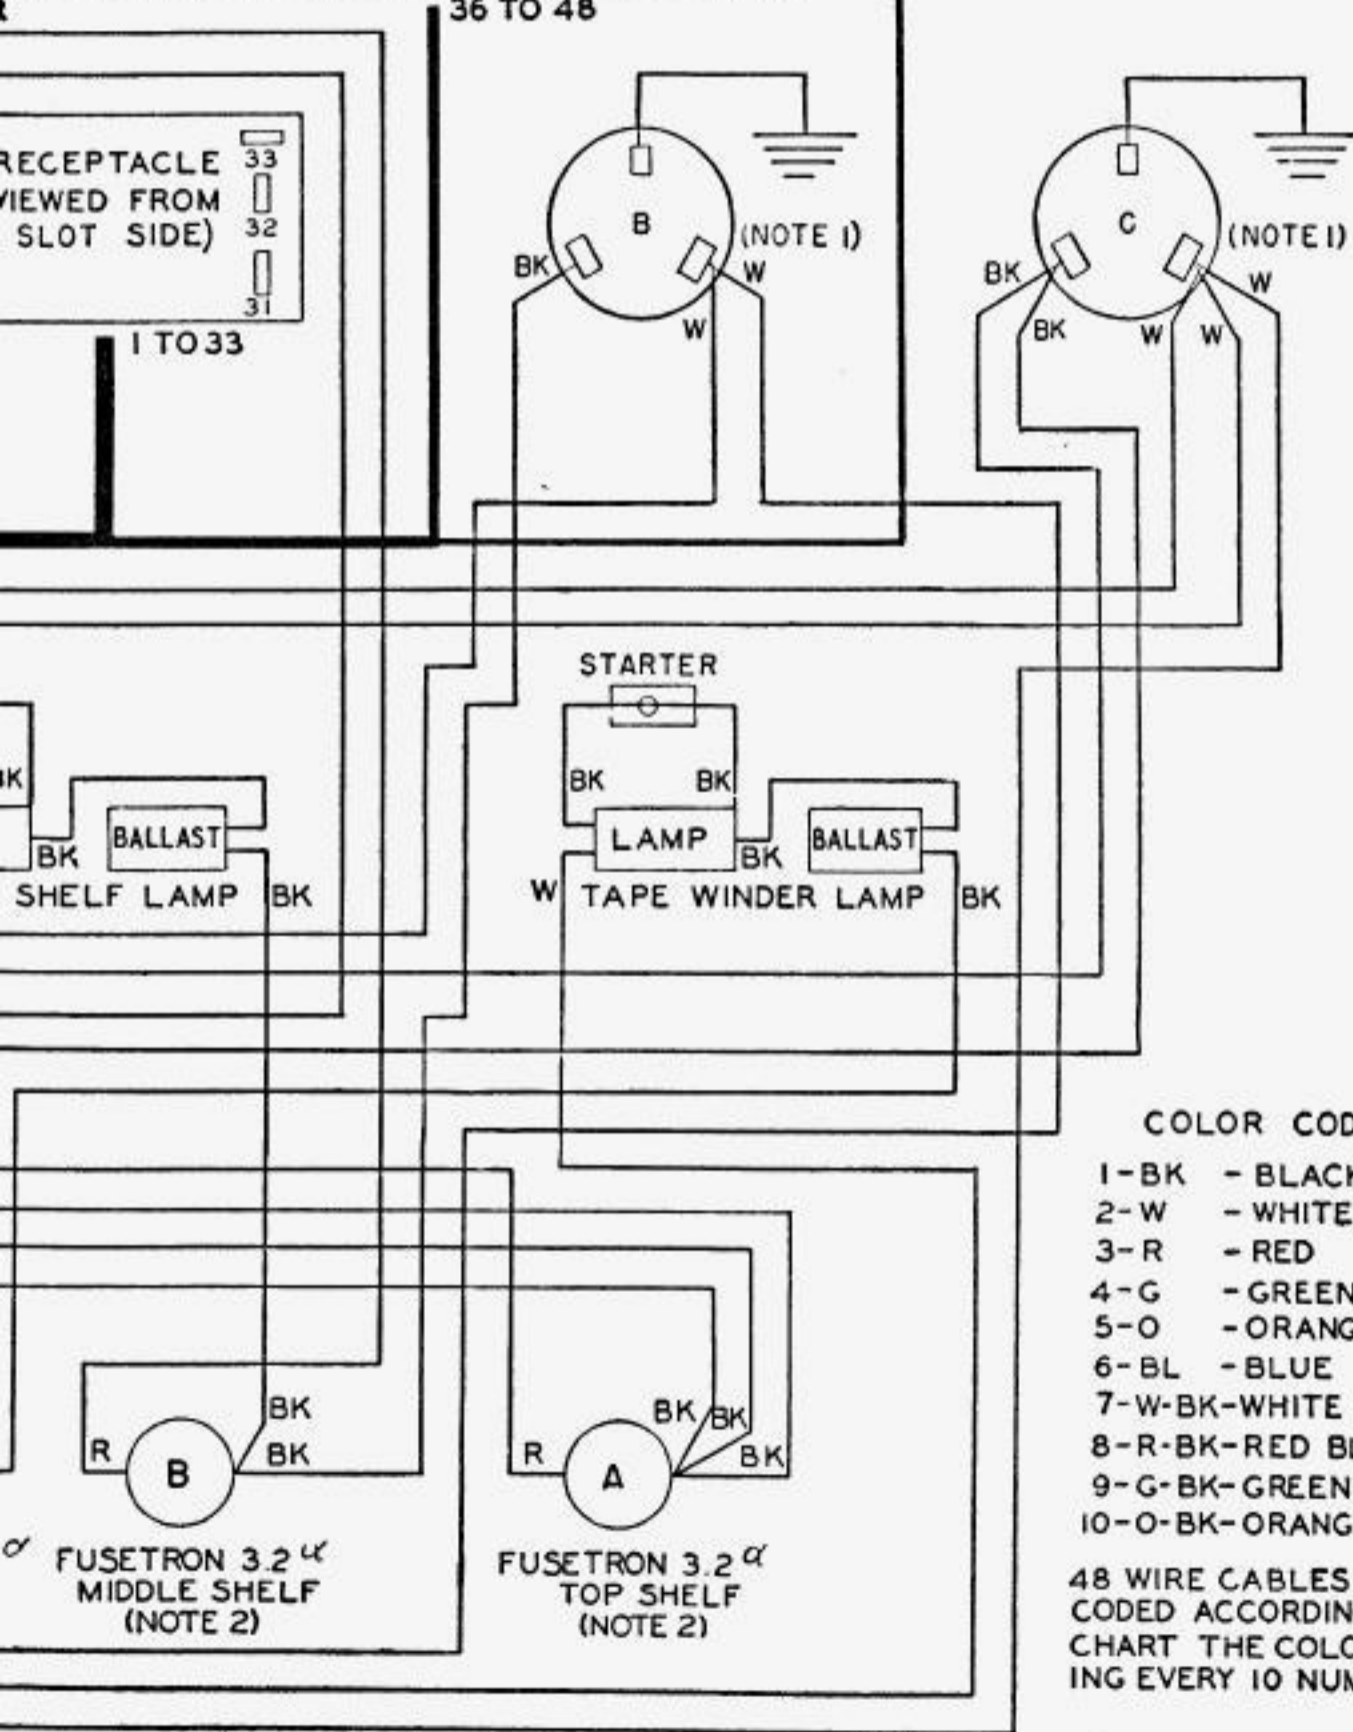

COLOR CODE

- 1-BK - BLACK
- 2-W - WHITE
- 3-R - RED
- 4-G - GREEN
- 5-O - ORANGE
- 6-BL - BLUE
- 7-W-BK-WHITE BLACK
- 8-R-BK-RED BLACK
- 9-G-BK-GREEN BLACK
- 10-O-BK-ORANGE BLACK

48 WIRE CABLES ARE COLOR CODED ACCORDING TO ABOVE CHART THE COLORS REPEATING EVERY 10 NUMBERS.